

SAFETY SIGNS CATALOGUE

express
**NUMBER
PLATES & SIGNS**

The impossible we do at once, Miracles take a little longer

Tel: 041 484 2834 • Fax: 041 484 3971

Email: stevehm@expresssigns.co.za

FB 1



Location of
fire fighting
equipment

FB 2



Fire extinguisher

FB 3



Fire hose

FB 4



Fire hydrant

FB 5



Fire alarm

FB 6



Sprinkler stop
valve

FB 7



Fire telephone

FB 8



Fire pump
connection

FB 9



Location of
fire blanket

FB 10



Fire marshal

GA 1



First aid
equipment

GA 2



General
direction

GA 3



Direction to
escape route

GA 4




Direction to
escape route

GA 5




Manned first
aid station

GA 6



Drinking
water

GA 7



Blasting point

GA 8



Travelling way

GA 9



Refuelling point

GA 10



Ladies toilet

GA 11



Gents toilet

GA 12



Refuge chamber

GA 13



Telephone

GA 14



Waiting place

GA 15




Emergency telephone

GA 16



Electric isolator switch

GA 17



Stairs going down

GA 18



Stairs going up

GA 19



Eye-wash

GA 20



Safety shower

GA 21



Location of bomb bag

MV 1



Eye protection shall be worn

MV 2




Respiratory protection shall be worn

MV 3



Head protection shall be worn

MV 4



Hearing protection shall be worn

MV 5



Hand protection shall be worn

MV 6



Foot and leg protection against liquids shall be worn

MV 7



Foot protection against crushing shall be worn

MV 8



Lifelines shall be worn

MV 9



Apron shall be worn

MV 10



Face protection shall be worn

MV 11



Air-supplied hood shall be worn

MV 12




Dust mask shall be worn

MV 13



Air extraction shall be used

MV 14



Keep area clean

MV 15



Screening to be used

MV 16



Use safety cage

PV 1



Smoking prohibited

PV 2



Fire and open flames prohibited

PV 3



Throughfare for pedestrians prohibited

PV 4



Water as
extinguishing
agent prohibited

PV 5



Drinking of this
water is
prohibited

PV 6



Proceeding beyond
this point prohibited

PV 7



Cycling prohibited

PV 8



Carrying of long
material prohibited

PV 9



Hand tramming
prohibited

PV 10



Tractors and
fork-lifts prohibited
beyond this point

PV 11



Use of compressed
air to dust body
prohibited

PV 12



Loose clothing, ties,
jewellery and unconfined
long hair prohibited

PV 13



Dumping prohibited

PV 14



Do not obstruct

PV 15



No entry for
heavy vehicles

PV 16



No entry for
vehicles

PV 17



Locomotives prohibited
beyond this point

PV 18



Wearing of safety
helmets prohibited

PV 19



Carrying of fire-
arms prohibited

PV 20



Dogs prohibited

PV 21



Cameras prohibited

PV 22



Alcohol prohibited

WW 1



General warning
of hazard

WW 2



Warning of fire
hazard

WW 3



Warning of
explosion hazard

WW 4



Warning of
corrosion hazard

WW 5



Warning of poisonous
substances hazard

WW 6



Warning of ionising
radiation hazard

SIZES: 150mm x 150mm; 190mm x 190mm; 290mm x 290mm; 440mm x 440mm
GROOTTES:

WW 7



General warning of electric shock hazard

WW 8



Warning of suspended loads hazard

WW 9



Warning of methane hazard

WW 10



Warning of fragile roof

WW 11



Warning of biological hazard

WW 12



Warning of laser hazard

WW 13




Warning of asbestos hazard

WW 14



Warning of workers overhead

WW 15



Warning of carbon dioxide hazard

WW 16



Warning of hazard of slippery walking surface

WW 17



Warning of hazard of moving machinery

WW 18



Warning of hazard of cold burns

WW 19



Beware of dogs

WW 20



Beware of forklifts

WW 21



Beware of material falling from moving conveyor belt

WW 22



Warning of hazard of slippery steps

WW 23



Beware of hazard of exposed live high-voltage equipment

ALL SYMBOLIC SAFETY SIGNS AVAILABLE IN ABS PLASTIC, CHROMADEK STEEL, VINYL STICKERS AND REFLECTIVE

ALLE SIMBOLIESE VEILIGHEIDSTEKENS BESKIKBAAR IN ABS-PLASTIEK, CHROMADEK-STAAI, VINIEL PLAKKERS EN WEERKAATS-MATERIAAL

SIZES:
GROOTTES:

290mm x 290mm; 440mm x 440mm

UNLESS OTHERWISE STATED
TENSY ANDERS VERMELD

**SEKERHEIDS-
GEBIED** **SECURITY
AREA**

GEEN
ONGEMAGTIGDE
TOEGANG  NO
UNAUTHORISED
ENTRY

PERMIT BY
ONTVANGS PERMIT AT
RECEPTION

DECLARATION OF ALL PROPERTY
AND GOODS REQUIRED.
PERSONS & VEHICLES LIABLE TO
SEARCH.

ALLE EIENDOM EN GOEDERE MOET
VERKLAAR WORD.
PERSONE EN VOERTUIG IS ONDER-
WORPE AAN DEURSOEKING.

IDENTITY CARDS MUST BE WORN.

TOEGANG  ENTRY
OP EIE AT OWN
RISIKO RISK

IDENTITEITSKAARTE VERPLIGTEND

SWW 1

**BRANDBEHEER
GEBIED**

**FIRE CONTROL
AREA**

FBW 1


ACCIDENTS
The New Standard

KM 020



**BREATHING APPARATUS
ASEMHALINGSAPARAAT**

KM 021


**KILLER
ON THE LOOSE**

KM 022



**OBVIOUS hazards can
cause SURPRISE falls.**

KM 031



**CARELESS FOOLS GET
CARRIED AWAY !**

KM 032



**IF IN DOUBT, CONSULT
YOUR SUPERVISOR**

KM 033




**SHORT-CUTS CAN
CUT LIVES SHORT**

KM 034



REPLACE GUARDS...
We don't want to replace you.

KM 035



**DEATH LURKS IN
CONFINED SPACES**

KM 036



KM 103



KM 104



KM 105



KM 106



KM 107



KM 108



KM 109



KM 110



KM 111



KM 112



KM 113



KM 115

SIZES:
GROOTTES:

290mm x 290mm; 440mm x 440mm

UNLESS OTHERWISE STATED
TENSY ANDERS VERMELD



KM 120



KM 121



KM 122



KM 123



KM 124



KM 125



KM 127



KM 126 600mm x 400mm



KM 128



KM 129 600mm x 400mm

OXYGEN
FULL

KM 130

L.P. GAS
EMPTY

KM 131

HELIUM
FULL

KM 132

OXYGEN
EMPTY

KM 133

L.P. GAS
FULL

KM 134

HELIUM
EMPTY

KM 135

ACETYLENE
FULL

KM 136

P 10 GAS
EMPTY

KM 137

CHLORINE
FULL

KM 138

ACETYLENE
EMPTY

KM 139

P 10 GAS
FULL

KM 140

CHLORINE
EMPTY

KM 141

WET OP BEROEPSGESONDHEID & VEILIGHEID (WET 85 VAN 1993)

**SOOS GEWYSIG
BYLAE D**

**KENNISGEWING TEN OPSIGTE VAN ANDER
MASJINERIE AS 'N STOOMKETEL**

1. Elke werkgever of gebruiker van masjinerie word by wet verplig om veiligheidsvoorsiening in verband met masjinerie te voorsien en iemand wat versuim om sodanige toerusting behoorlik te gebruik of daaraan te-ter, begaan 'n misdryf.
2. Geen persoon wat in die onmiddellike nabyheid van masjinerie werk, mag enige los boklere, enige juwelersware of ornament, enige horlosie of sleutelketting, enige lang loshangende hare of enigiets dra wat in die bewegende dele van sodanige masjinerie opgevang kan word nie.
3. Tensy 'n toestel goedgekeur deur 'n inspekteur gebruik word, mag 'n dryfband nie opgesit op afgewoone word terwyl masjinerie in werking is nie, behalwe in die geval van 'n ligte band wat op die keëlvormige ka-rol van masjinerie gereedskap verplaas mag word ten einde die werksnel-heid van sodanige gereedskap te verander.
4. Masjinerie wat in werking is mag nie skoongemaak, herstel, verstel of ge-olie word nie, tensy sodanige masjinerie deur 'n bevoegde persoon skoongemaak, herstel, verstel of ge-olie word wanneer dit ondoenlik is om sodanige masjinerie te stop.
5. Geen ander persoon as 'n bevoegde persoon mag die beskermde gebied van masjinerie wat in werking is, betree nie, en dan slegs as dit ongedoenlik is om sodanige masjinerie te stop.
6. Geen persoon wat onder die invloed van alkohol of verdowingsmid-dels is mag 'n perseel waar masjinerie gebruik word binnegaan nie.
7. Enige ongeluk of ander voorval wat die veiligheid van werknemers bedreig of waarskynlik sal bedreig, moet onverwyl aan die werkgever of gebruiker van masjinerie aangemeld word.
8. Geen persoon wat oor masjinerie toesig hou en geen persoon wat masjinerie hanteer, mag ander persoon magtig om sy werk te doen sonder die toestemming van sy hoof nie.
9. Enige persoon wat voorneme is om masjinerie aan te skakel moet voordat hy dit doen, homself tevrede stel dat geen ander persoon in gevaar gestel word nie.

KM 142

880mm x 440mm

THE OCCUPATIONAL HEALTH & SAFETY ACT (85 OF 1993)

**GENERAL MACHINERY REGULATIONS
SCHEDULE D**

**NOTICE IN RESPECT OF MACHINERY OTHER
THAN A BOILER**

1. Every employer or user of machinery is required by law to provide safety equipment in connection with machinery, and it is an offence for any person to fail to use such equipment properly or to interfere with them.
2. No person working in close proximity to moving machinery shall wear any loosely fitting outer clothing, any jewelry or anything which may be caught up in the moving parts of such machinery.
3. Unless an apparatus approved by an inspector is used, no driving belt shall be shipped or unshipped whilst machinery is in motion, except in the case of a light belt which may be shipped on the coned pulley of a machine tool in order to alter the working speed of such tool.
4. machinery in motion shall not be cleaned, repaired, adjusted or oiled, unless such machinery is cleaned, repaired, adjusted or oiled by a competent person when it is impracticable to stop such machinery.
5. No person other than a competent person shall enter the safeguarded area of machinery in motion, and then only if it is impracticable to stop such machinery.
6. No person under the influence of alcohol or drugs shall enter any premises where machinery is used.
7. Any accident or other incident which threatens or is likely to threaten the safety of employees shall be reported immediately to the employer, or user of machinery.
8. No person supervising machinery and no person operating machinery shall, without the permission of his superior, authorize any other person to do his work.
9. Any person intending to start a machine shall before doing so satisfy himself that no other person is endangered.

KM 143

880mm x 440mm

THE OCCUPATIONAL HEALTH & SAFETY ACT (85 OF 1993)

**GENERAL MACHINERY REGULATIONS
SCHEDULE C**

NOTICE IN RESPECT OF BOILERS

1. Every employer or user of machinery is required by law to provide safety equipment in connection with machinery, and it is an offence for any person to fail to use such equipment properly or to interfere with them.
2. No boiler shall be worked at a higher pressure than the authorised working pressure.
3. Unless steam is drawn for the operation of the boiler's auxiliary apparatus, no person shall draw steam from the boiler otherwise than through the main steam stop valve.
4. No person shall enter a boiler or its flues, unless it is safe and the steam-stop valve, feed valve, blow-off valve and all other valves or cocks are blanked off.
5. Portable electric lights used during the cleaning, repair or inspection of a boiler shall not exceed 50V.
6. No person shall cause water to come into contact with hot flue dust or ashes if it threatens or is likely to threaten the safety of employees.
7. Any accident or other incident which threatens or is likely to threaten the safety of employees shall be reported immediately to the employer, or user of machinery.

KM 144

600mm x 440mm

WET OP BEROEPSGESONDHEID & VEILIGHEID (WET 85 VAN 1993)

**SOOS GEWYSIG
BYLAE C**

**KENNISGEWING TEN OPSIGTE VAN
STOOMKETELS**

1. Elke werkgever of gebruiker van masjinerie word by wet verplig om veiligheidsvoorsiening in verband met masjinerie te voorsien en iemand wat versuim om sodanige toerusting behoorlik te gebruik of daaraan te-ter, begaan 'n misdryf.
2. Geen stoomketel mag teen 'n hoër druk as die gemagtigde werksdruk werk nie.
3. Tensy stoom vir die werking van die stoomketel se hulptoestel getrek word, mag niemand stoom anders as deur die hoofstoomafsluitklep uit die stoomketel trek nie.
4. Geen persoon mag 'n stoomketel of sy gasgange binnegaan nie, tensy dit veilig is en die stoomafsluitklep, voerklep, afblaasklep en alle ander kleppe of krane afgesluit is.
5. Draagbare elektriese ligte wat gedurende skoonmaak, herstel of ondersoek van 'n stoomketel gebruik word, mag nie 50V oorskry nie.
6. Niemand mag water met warm vuurgangstof of -as in aanraking laat kom indien dit die veiligheid van werknemers bedreig of waarskynlik sal bedreig nie.
7. Enige ongeluk of ander voorval wat die veiligheid van werknemers bedreig of waarskynlik sal bedreig, moet onverwyl aan die werkgever of gebruiker van masjinerie aangemeld word.

KM 145

600mm x 440mm

**SIZES:
GROOTTES:**

290mm x 290mm; 440mm x 440mm

**UNLESS OTHERWISE STATED
TENSY ANDERS VERMELD**

DANGER
UNAUTHORISED ENTRANCE
PROHIBITED
THIS ENCLOSURE CONTAINS
HIGH VOLTAGE
ELECTRICAL APPARATUS
GEVAAR
ONGEMAGTIGDE
INGANG VERBODE
HIERDIE AFLUITING BEVAT
HOË SPANNING
ELEKTRIESE APPARAAT



WARNING
UNAUTHORISED HANDLING
AND TAMPERING WITH
ELECTRICAL APPARATUS
PROHIBITED
WAARSKUWING
ALLE ONGEMAGTIGDE
PERSONE BELET OM
ELEKTRIESE TOESTELLE
TE HANTEER OF DAARAN
TE PEUTER

ELECTRIC SHOCK TREATMENT
INSTRUCTIONS FOR RESCUE BREATHING
IMMEDIATE ACTION IS ESSENTIAL

- DO NOT TOUCH CASUALTY WITH YOUR BARE HANDS. ARREST THE CURRENT WITH THE LIFE WIRE.
- SWITCH OFF CURRENT IF POSSIBLE.
- IMMEDIATELY STAY AWAY FROM A PIECE OF WOOD OR A THICK FOLDED BLANKET OR COAT.
- USING A DRY ROPE, BELT OR STRAP, MOVE LIFE WIRE FROM CASUALTY OR DRAG HIM AWAY FROM WIRE.

SEND FOR MEDICAL ASSISTANCE.

- DO NOT SPEAK STRONG WORDS ORDERED BY A DOCTOR.
- KEEP CASUALTY WARM AND DO NOT REMOVAL.
- IF PATIENT IS BREATHING, KEEP HIM FLAT, COVER WITH BLANKETS OR COATS.

PERFORM MOUTH-TO-MOUTH ARTIFICIAL RESPIRATION

1. TURN HEAD OF CASUALTY ON HIS BACK AND NOT ON HIS SIDE. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE.
2. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE.
3. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE.
4. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE.
5. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE.
6. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE.
7. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE.
8. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE.
9. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE.
10. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE. PLACE THE CASUALTY ON HIS BACK AND NOT ON HIS SIDE.

BEHANDELING VIR ELEKTRIESE SKOK
VOORSKRIFTE VIR REDDINGSASSEMHALING
ONMIDDELLIKE OPTREDE IS NOODSAKLIK

- MOET NIE KASUALTEIT MET JOU EIGEN HANDE AANRAAK.
- MOET NIE KASUALTEIT MET JOU EIGEN HANDE AANRAAK.
- MOET NIE KASUALTEIT MET JOU EIGEN HANDE AANRAAK.
- MOET NIE KASUALTEIT MET JOU EIGEN HANDE AANRAAK.
- MOET NIE KASUALTEIT MET JOU EIGEN HANDE AANRAAK.
- MOET NIE KASUALTEIT MET JOU EIGEN HANDE AANRAAK.
- MOET NIE KASUALTEIT MET JOU EIGEN HANDE AANRAAK.
- MOET NIE KASUALTEIT MET JOU EIGEN HANDE AANRAAK.
- MOET NIE KASUALTEIT MET JOU EIGEN HANDE AANRAAK.
- MOET NIE KASUALTEIT MET JOU EIGEN HANDE AANRAAK.

ONTREDE MEDIESE HULP.

- MOET NIE KASUALTEIT MET JOU EIGEN HANDE AANRAAK.
- MOET NIE KASUALTEIT MET JOU EIGEN HANDE AANRAAK.
- MOET NIE KASUALTEIT MET JOU EIGEN HANDE AANRAAK.
- MOET NIE KASUALTEIT MET JOU EIGEN HANDE AANRAAK.
- MOET NIE KASUALTEIT MET JOU EIGEN HANDE AANRAAK.
- MOET NIE KASUALTEIT MET JOU EIGEN HANDE AANRAAK.
- MOET NIE KASUALTEIT MET JOU EIGEN HANDE AANRAAK.
- MOET NIE KASUALTEIT MET JOU EIGEN HANDE AANRAAK.
- MOET NIE KASUALTEIT MET JOU EIGEN HANDE AANRAAK.
- MOET NIE KASUALTEIT MET JOU EIGEN HANDE AANRAAK.

PAS DIE MOND-TEEN-MOND-ASSEMHALINGSMETODE TOE.

1. STEL DIE SKOK-TOESTEL OP 'N PLATTE, VASTE OPPERFLAK.
2. STEL DIE SKOK-TOESTEL OP 'N PLATTE, VASTE OPPERFLAK.
3. STEL DIE SKOK-TOESTEL OP 'N PLATTE, VASTE OPPERFLAK.
4. STEL DIE SKOK-TOESTEL OP 'N PLATTE, VASTE OPPERFLAK.
5. STEL DIE SKOK-TOESTEL OP 'N PLATTE, VASTE OPPERFLAK.
6. STEL DIE SKOK-TOESTEL OP 'N PLATTE, VASTE OPPERFLAK.
7. STEL DIE SKOK-TOESTEL OP 'N PLATTE, VASTE OPPERFLAK.
8. STEL DIE SKOK-TOESTEL OP 'N PLATTE, VASTE OPPERFLAK.
9. STEL DIE SKOK-TOESTEL OP 'N PLATTE, VASTE OPPERFLAK.
10. STEL DIE SKOK-TOESTEL OP 'N PLATTE, VASTE OPPERFLAK.

**ELECTRICAL SUB-STATIONS
PROCEDURE IN CASE
OF FIRES
NO 1 ONLY
APPLIES TO OPERATING
STAFF**

1. IMMEDIATELY NOTIFY THE ENGINEER, FOREMAN ELECTRICIAN OR SHIFT ELECTRICIAN.
2. THE RESPONSIBLE PERSON (ENGINEER FOREMAN ELECTRICIAN OR SHIFT ELECTRICIAN) MUST SATISFY HIMSELF THAT THE POWER HAS BEEN CUT OFF AND THEN IMMEDIATELY PUT INTO USE THE CO₂ FIRE EXTINGUISHERS.

**WATER MUST NEVER
BE USED**

SHOULD ONE EXTINGUISHER NOT QUENCH THE FIRE COMPLETELY, OTHERS MUST BE TAKEN FROM THE OTHER SUB-STATIONS.

THE POWER MUST NOT BE PUT ON UNTIL AUTHORITY TO DO SO HAS BEEN GIVEN BY THE ENGINEER OR FOREMAN ELECTRICIAN.

**ELEKTRIESE SUB-STASIE
STAPPE INGEVAL
VAN VUUR
NR. 1 ALLEENLIK
VAN TOEPASSING OP
PERSONEEL IN BEHEER**

1. STEL ONMIDDELLIK DIE INGENIEUR, VOORMAN ELEKTRISIËN OF SKOF-ELEKTRISIËN IN KENNIS.

2. DIE VERANTWOORDELIKE PERSOON (INGENIEUR VOORMAN ELEKTRISIËN OF SKOF-ELEKTRISIËN) MOET HOMSELF TEVERDE STEL DAT DIE KRAG AFGEKAKEL IS EN DAN ONMIDDELLIK DIE CO₂ VUUR BLUSSERS IN WERKING STEL.

**WATER MAG NOOIT
GEBRUIK WORD NIE**

INDIEN EEN BLUSSER NIE DIE VUUR HEELTEMAL BLUS NIE MOET BLUSSERS VAN ANDER SUBSTASIES GENEEM WORD.

DIE KRAG MAG NIE AANGESKAKEL WORD ALVORENS MAGTIGING DAARTOE VERLEEN IS DEUR DIE INGENIEUR OF VOORMAN ELEKTRISIËN NIE.

KM 146

700mm x 1040mm

UNAUTHORISED ENTRANCE
PROHIBITED
ONGEMAGTIGDE INGANG
VERBODE

AKEKHO OVUNYELWE
UKUNGENA LAPHLA

WARNING
ALL UNAUTHORISED PERSONS ARE
PROHIBITED FROM HANDLING
OR INTERFERING WITH
ELECTRICAL APPARATUS
WAARSKUWING
ALLE ONGEMAGTIGDE PERSONE IS
BELET OM ELEKTRIESE TOESTELLE TE
HANTEER OF DAARAN TE PEUTER

**PROCEDURE IN
GEVALLE VAN BRAND**
No. 1 SLEGS OP
TOEPASSING VAN
TOEPASSING.

1. STEL DIE SKOK-TOESTEL OP 'N PLATTE, VASTE OPPERFLAK.
2. DIE VERANTWOORDELIKE PERSOON (VOORMAN OF SKOF-ELEKTRISIËN) MOET HOMSELF TEVERDE STEL DAT DIE KRAG AFGEKAKEL IS, DAARNA MOET HY DIE CO₂ BRANDBLUSSERS ONMIDDELLIK GEBRUIK.

WATER MOET NOOIT GEBRUIK WORD NIE.
AS EEN BLUSSER DIE BRAND NIE HEELTEMAL DOORTREK, MOET ANDERS VAN DIE ANDER SUB-STASIES GENEEM WORD. DIE KRAG MOET NIE WEER AANGESKAKEL WORD VOORDAT MAGTIGING OM DIT TE DOEN, DEUR DIE VOORMAN-ELEKTRISIËN GEGEE IS NIE.

**PROCEDURE
IN CASE OF FIRE**
No. 1 ONLY APPLIES TO
OPERATING STAFF.

1. IMMEDIATELY NOTIFY THE SHIFT ELECTRICIAN.
2. THE RESPONSIBLE PERSON (FOREMAN OR SHIFT ELECTRICIAN) MUST SATISFY HIMSELF THAT THE POWER HAS BEEN CUT OFF AND THEN IMMEDIATELY PUT INTO USE THE CO₂ FIRE EXTINGUISHERS.

WATER MUST NEVER BE USED.
SHOULD ONE EXTINGUISHER NOT QUENCH THE FIRE COMPLETELY, OTHERS MUST BE TAKEN FROM THE OTHER SUB-STATIONS. THE POWER MUST NOT BE PUT ON UNTIL AUTHORITY TO DO SO HAS BEEN GIVEN BY THE FOREMAN ELECTRICIAN.

**FIRST AID TREATMENT OF
ELECTRICAL ACCIDENTS**

1. ASSESS WHETHER THERE IS A LIVE APPARATUS OR CONDUCTOR.
2. IF NECESSARY, APPLY FIRST AID.

NOTE: PATIENT COMFORTABLE AND KEEP HIM AT NORMAL BODY TEMPERATURE COVER HIM WITH BLANKETS OR COATS ONLY IF HE IS COLD.

IF PATIENT IS NOT BREATHING, PERFORM RESCUE BREATHING AT ONCE



ON ACCOUNT OF FACIAL INJURIES OR OTHER REASONS, RESCUE BREATHING CANNOT BE PERFORMED, APPLY RESCUE BREATHING AT ONCE.

SYSTOLIC BREATHING METHOD OF ARTIFICIAL RESPIRATION



RESCUE BREATHING METHOD OF ARTIFICIAL RESPIRATION



RESCUE BREATHING METHOD OF ARTIFICIAL RESPIRATION



RESCUE BREATHING METHOD OF ARTIFICIAL RESPIRATION



RESCUE BREATHING METHOD OF ARTIFICIAL RESPIRATION



RESCUE BREATHING METHOD OF ARTIFICIAL RESPIRATION



RESCUE BREATHING METHOD OF ARTIFICIAL RESPIRATION



RESCUE BREATHING METHOD OF ARTIFICIAL RESPIRATION

**NOODHULP IN DIE GEVAL
VAN ELEKTRIESE SKOK**

1. ASSESS WHETHER THERE IS A LIVE APPARATUS OR CONDUCTOR.
2. IF NECESSARY, APPLY FIRST AID.

NOTE: PATIENT COMFORTABLE AND KEEP HIM AT NORMAL BODY TEMPERATURE COVER HIM WITH BLANKETS OR COATS ONLY IF HE IS COLD.

IF PATIENT IS NOT BREATHING, PERFORM RESCUE BREATHING AT ONCE



ON ACCOUNT OF FACIAL INJURIES OR OTHER REASONS, RESCUE BREATHING CANNOT BE PERFORMED, APPLY RESCUE BREATHING AT ONCE.

SYSTOLIC BREATHING METHOD OF ARTIFICIAL RESPIRATION



RESCUE BREATHING METHOD OF ARTIFICIAL RESPIRATION



RESCUE BREATHING METHOD OF ARTIFICIAL RESPIRATION




RESCUE BREATHING METHOD OF ARTIFICIAL RESPIRATION



RESCUE BREATHING METHOD OF ARTIFICIAL RESPIRATION



RESCUE BREATHING METHOD OF ARTIFICIAL RESPIRATION



RESCUE BREATHING METHOD OF ARTIFICIAL RESPIRATION



RESCUE BREATHING METHOD OF ARTIFICIAL RESPIRATION



RESCUE BREATHING METHOD OF ARTIFICIAL RESPIRATION

**FIRE-DANGER
INDICATOR
BRANDGEVAAR
AANWYSER**

**HIGH
HOOG**

MEDIUM

**LOW
LAAG**

KM 147

850mm x 880mm

KM 148 880mm x 440mm

SIZES:
GROOTTES:

290mm x 290mm; 440mm x 440mm

UNLESS OTHERWISE STATED
TENSY ANDERS VERMELD

COMPANY
LOGO

COMPANY NAME

SAFETY



VEILIGHEID

NOSA
GRADING



NOSA
GRADERING

WE HAVE WORKED

SLOTS, PERSPEX OR
MAGNETIC VINYL

SHIFTS WITHOUT DISABLING INJURY

TARGET:

SLOTS, PERSPEX OR
MAGNETIC VINYL

SHIFTS

PREVIOUS RECORD:

SLOTS, PERSPEX OR
MAGNETIC VINYL

SHIFTS

LAST INJURY BY MEMBER OF

SLOTS, PERSPEX OR
MAGNETIC VINYL

DEPARTMENT

YOUR SAFETY SLOGAN

KM 149

2450mm x 2450mm

DO NOT MAKE USE OF THE LIFTS
IN THE EVENT OF FIRE



IN GEVAL VAN VUUR MOET
DIE HYSERS NIE GEBRUIK WORD NIE

KM 150


200mm x 400mm

COME IN / KOM BINNE



PLEASE CLOSE THE DOOR
MAAK ASB. DIE DEUR TOE

KM 151

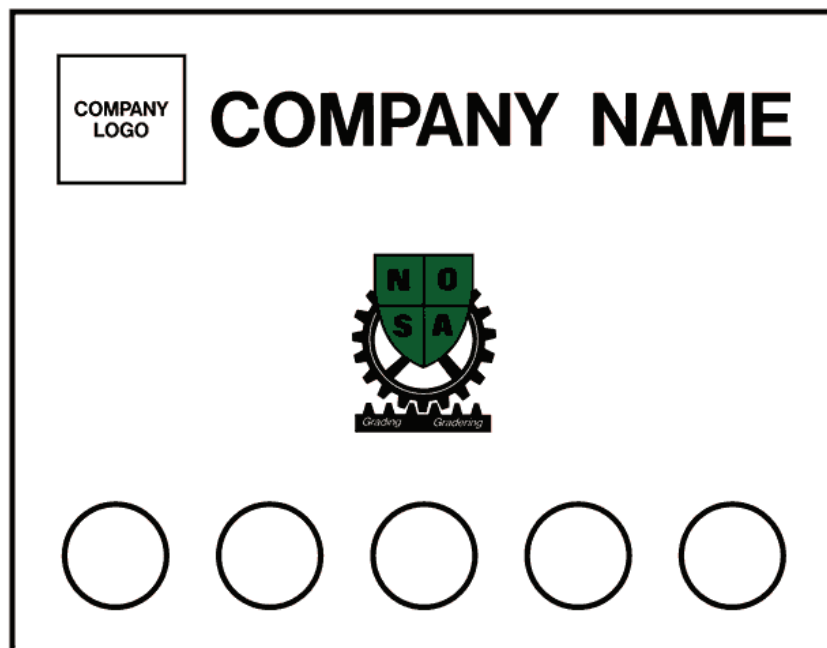

KM 152

1220mm X 1580mm

**SHOPLIFTING IS A
CRIMINAL
OFFENCE**

**WINKEL-
DIEFSTAL
IS 'N**

KRIMINELE OORTREDING



KM 153



6,600 volt

KM 154

**WEAVE THROUGH
THE TRAFFIC....
AND YOU'LL
END UP
IN STITCHES**

KM 155

**DON'T SPEED,
YOU MIGHT
GET THERE
DEAD ON TIME**

KM 156

**DRIVE DEAD
SLOW,
OR
DIE FAST!**

KM 157



KM 158



KM 159



KM 160



KH 221



KH 222



KH 223



KH 224



KH 225



KH 226



KH 227



KH 228



KH 229



KH 230



KH 231



KH 232



KH 233



KH 234



KH 235



KH 236



KH 237



KH 238



KH 239



KH 240



KH 241



KH 242



KH 243



KH 244



KH 245



KH 246



KH 247



KH 248



KH 249



KH 250



KH 251



KH 252



KH 253



KH 254



KH 255



KH 256




KH 257



KH 258



KH 259

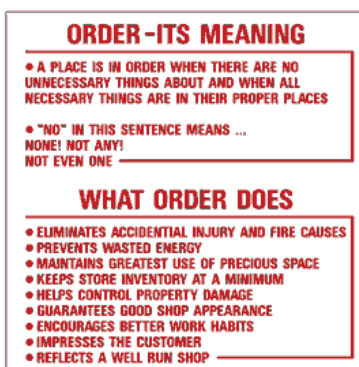


KH 260



KH 261



KH 262

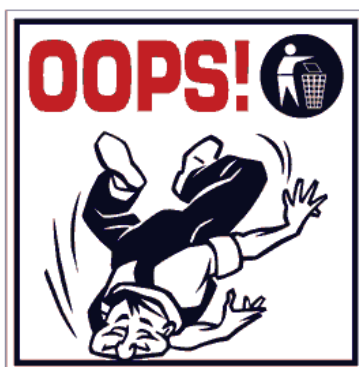

KH 263



KH 264



KH 265



KH 266



KH 267



KH 268

VIER STAPPE TOT VEILIGHEID

1. IS DIT 'N GEVAARLIKE SITUASIE?
2. IS HIER GEREEDSKAP OF UITRUSTING WAT GEVAARLIK IS?
3. DOEN DIE WERKERS ENIGIETS GEVAARLIKS?
4. WAT GAAN EK NOU DAARAAN DOEN?

KH 271

310 mm x 610mm



KH 275

FOUR STEPS TO SAFETY

1. IS THIS A DANGEROUS SITUATION?
2. ARE THERE TOOLS OR EQUIPMENT HERE WHICH ARE DANGEROUS?
3. ARE THE MEN DOING ANYTHING DANGEROUS?
4. WHAT AM I GOING TO DO ABOUT IT?

KH 272

310 mm x 610mm



KH 276

LO NDLELA KA LO VIMBELA LO NGOZI

1. MINA SETSHA LO NDAWO
2. MINA SETSHA LO MPAHLA KA LO VIMBELA LO NGOZI NA LO MPAHLA KA LO JOB
3. MINA SETSHA NOKO LO MADODA YENA JOBA KA LO NDLELA KA LO VIMBELA LO NGOZI
4. MINA LUNGISA

KH 273

310 mm x 610mm



KH 277

IZINYATHELO EZINE EZIPHEPHILE

1. YINDAWO EYINGOZI LENA?
2. KUKHONA AMATHULUSI NOMA KULENDAWO YIMAPHI AYINGOZI?
3. KUSETSHENZWA NGENGOZI NOMA?
4. MINA NGIYOKWENZA NJANI NGALOKHU?

KH 274

310 mm x 610mm



KH 278



KS 331



KS 332



KS 333



KS 334



KS 335



KS 336



KS 337

440 mm x 880mm



KS 338



KS 340



KS 341



KS 342



KW 451



KW 452



KW 453



KW 454



KW 455



KW 456



KW 457

440mm x 880mm



KW 458



KW 460


440mm x 880mm



KW 462



KM 524

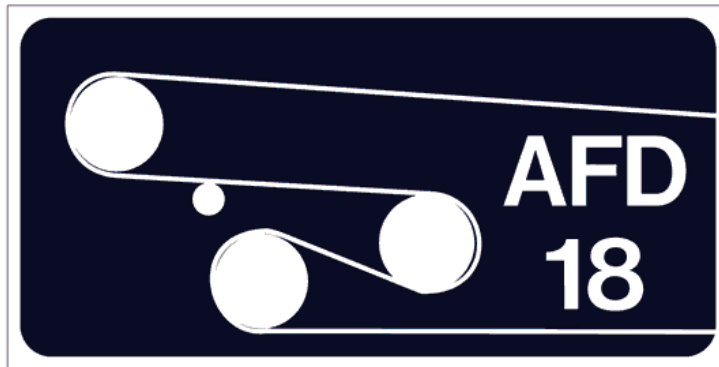

KM 526


440mm x 880mm



KM 529




KM 530

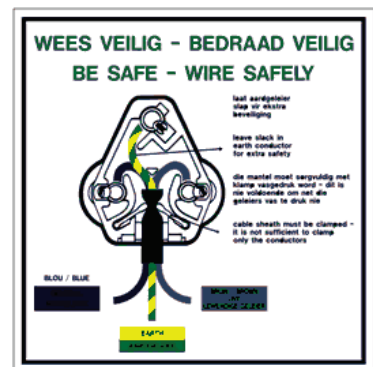


KM 531



KM 532

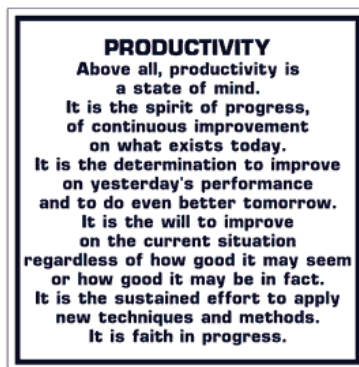

KM 533

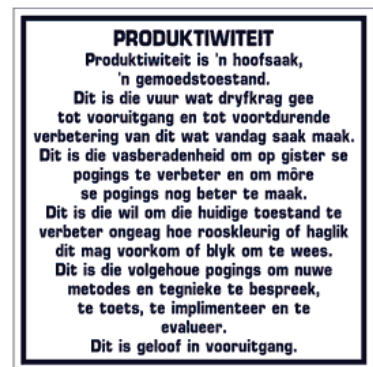

KM 534



KM 535



KM 536



KM 537

**BLASTING
NO ENTRY**

**SKIETGEBIED
GEEN TOEGANG**

KB 611

**OLD
EXPLOSIVES**

**OU
SPRINGSTOWWE**

KB 612

**OLD
DETONATORS**

**OU
SLAGDOPPIES**

KB 613

**DETONATORS
SLAGDOPPIES**

KB 614

440mm x 880mm

**WASTE
AFVAL**

KB 617

**EXPLOSIVES MAGAZINE
& FENCES**

**PLOFSTOFMAGASYN
EN OMHEININGS**

KB 615

440mm x 880mm

**REEF
RIF**

KB 618

**SPRINGSTOWWE
EXPLOSIVES**

KB 616

440mm x 880mm



KB 619

INSTRUCTIONS FOR THE FIRST AID TREATMENT OF CASES OF GASSING

- 1 NOTIFY THE FIRST AID ROOM AND A DOCTOR OF THE OCCURRENCE IMMEDIATELY
 - 2 DO NOT ENTER A GAS POLLUTED AREA UNLESS YOU ARE USING A SUITABLE GASMASK
 - 3 DO NOT ENTER A GAS POLLUTED AREA ALONE. A RESCUE TEAM SHOULD COMPRISE AT LEAST TWO MEMBERS
 - 4 IF GASSING OCCURRED IN A CONFINED SPACE OR IN A ROOM VENTILATE AS WELL AS POSSIBLE BY BLOWING OUT WITH COMPRESSED AIR IF AVAILABLE OR BY OPENING WIDE ALL DOORS AND WINDOWS
 - 5 REMOVE THE PATIENT TO THE NEAREST FRESH AIR IMMEDIATELY
 - 6 IF BREATHING HAS CEASED OR IS IRREGULAR
 - (a) PERFORM ARTIFICIAL RESPIRATION FOR AT LEAST HALF AN HOUR AFTER THE PATIENT HAS BEEN REMOVED TO FRESH AIR. DELAY MAY CAUSE THE DEATH OF A PATIENT
 - (b) ADMINISTER OXYGEN AS SOON AS BREATHING HAS RECOMMENCED
 - (c) REMOVE THE PATIENT TO THE FIRST AID ROOM AS SOON AS POSSIBLE
 - 7 IF THE PATIENT IS UNCONSCIOUS BUT BREATHING REGULARLY ADMINISTER OXYGEN UNTIL HE COMES ROUND AND CONTINUE FOR AT LEAST HALF AN HOUR AND ALSO WHILST REMOVING HIM TO THE FIRST AID ROOM ON NO ACCOUNT POUR WATER OVER HIM
 - 8 IF THE PATIENT IS CONSCIOUS REMOVE HIM TO THE FIRST AID ROOM IMMEDIATELY WHILE ADMINISTERING OXYGEN. DO NOT PERMIT A PERSON WHO HAS INHALED A NOXIOUS GAS TO WALK. CARRY HIM ON A STRETCHER
 - 9 ALL CASES OF GASSING NO MATTER HOW SLIGHT MUST BE REPORTED TO A DOCTOR WITHOUT DELAY
 - 10 REMEMBER THAT SYMPTOMS OF GAS POISONING MAY IN MANY CASES AT FIRST BE VERY SLIGHT. IRRITATION OF EYES, NOSE AND THROAT, TIGHT FEELING ACROSS THE CHEST, HEADACHE OR DIZZINESS IN CERTAIN CASES GAS POISONING HAS A DELAYED ACTION
- CONSIDER SUCH SYMPTOMS AS DANGER SIGNALS

VOORSKRIFTE VIR EERSTEHULPBEHANDELING IN GEVAL VAN VERGASSING

- 1 VERWITTIG DIE EERSTEHULPKAMER EN 'N GENEESHEER ONMIDDELIK VAN DIE VOORVAL
 - 2 MOENIE 'N GASBESMETTE GEBIED BETREE TENSY U 'N GEPASTE GASMASKER GEBRUIK NIE
 - 3 MOENIE 'N GASBESMETTE GEBIED ALLEEN BETREE NIE. 'N REDDINGSPAN BE HOORT UIT MINSTENS TWEE PERSONE TE BESTAAN
 - 4 INDIEN VERGASSING IN 'N BEPERKTE RUIMTE OF KAMER VOORGEKOM MET VENTILEER DIE RUIMTE SO GOED MOONTLIK DEUR MET DRUKLUG UIT TE BLAAS. INDIEN DRUKLUG BESKIKBAAR IS OF DEUR ALLE DEURE EN VENSTERS WYD OOP TE MAAK
 - 5 VERWYDER DIE PASIËNT DADELIK NA DIE NAASTE VARS LUG
 - 6 INDIEN ASEMHALING OPGEHOU HET OF ONREËLMATIG IS
 - (a) PAS DADELIK KUNSMATIGE ASEMHALING TOE VIR TEN MINSTE 'N HALFUUR SODRA DIE PASIËNT IN VARS LUG GEBRING IS. VERTRAGING KAN DIE PASIËNT SE DOOD VEROORSAAK
 - (b) DIEN SUURSTOF TOE SODRA DIE PASIËNT WEER ASEMHAAL
 - (c) VERWYDER DIE PASIËNT NA DIE EERSTEHULPKAMER SO GOU MOONTLIK
 - 7 AS DIE PASIËNT BEWUSTELOOS IS MAAR REËLMATIG ASEMHAAL, DIEN SUURSTOF TOE TOTDAT HY BYKOM EN VIR MINSTENS 'N HALFUUR DAARNA EN OOK TERWYL HY VERWYDER WORD NA DIE EERSTEHULPKAMER. MOET ONDER GEEN OMSTANDIGHED WATER OOR HOM UITGOOI NIE
 - 8 AS DIE PASIËNT BY SY BEWUSSYN IS, VERWYDER HOM DADELIK NA DIE EERSTE HULPKAMER TERWYL SUURSTOF TOEGEDIEN WORD. MOENIE IEMAND WAT SKADELIKE GAS INGEASEM HET TOELAAT OM TE LOOP NIE. DRA HOM OP 'N DRAAGBAAR
 - 9 ALLE GEVALLE VAN VERGASSING, HOE GERING OOK AL, MOET SONDER VERSUIM BY 'N GENEESHEER AANGEMELD WORD
 - 10 ONTHOU DAT DIE SIMPTOME VAN GASVERGIFTIGING AANVANKLIK IN BAIE GEVALLE GERING MAG WEES: PRIKKELING VAN DIE OË, NEUS EN KEEL, 'N GEVOEL VAN BEKLEMMING IN DIE BORS, HOOPFYN OF DUISELIGHEID. IN SEKERE GEVALLE HET GASVERGIFTIGING 'N VERTRAAGDE UITWERKING
- BESKOU SODANIGE SIMPTOME AS GEVAARTEKENS

KO 701

400mm x 600mm

INSTRUCTIONS FOR THE FIRST AID TREATMENT OF CASES OF GASSING

- 1 Turn on the compressed air and ventilation at once, and keep it on
- 2 Do not enter the danger zone alone. Make no attempt at rescue until the foul air has been thoroughly blown out, unless the rescue gang wear oxygen breathing apparatus. No rescue party should consist of less than three.
- 3 Remove the affected man to the nearest good air at once.
- 4 Notify a responsible mine official at once.
- 5 If breathing has ceased, or is irregular
 - (a) PERFORM ARTIFICIAL RESPIRATION as soon as the patient is in good air. Any delay may mean death.
 - (b) ADMINISTER OXYGEN FROM THE CYLINDER IF POSSIBLE
- 6 If the patient is unconscious, but breathing regularly, administer oxygen until he comes round, or for at least half an hour before moving him. On no account throw water over him.
- 7 If the patient is conscious get him up to the surface as soon as possible
- 8 All cases of gassing, no matter how slight, must be reported to the Medical Officer. Do not allow a gassed person to walk. Carry him on a stretcher
- 9 Remember that gassing symptoms may be very slight at first: irritation of eyes, nose and throat, tight feeling across the chest or headache.

THESE ARE DANGER SIGNALS

VOORSKRIFTE VIR EERSTEHULPBEHANDELING IN GEVAL VAN GASVERGIFTIGING

1. Draai dadelik die druklug en ventilasie oop, en hou dit oop.
2. Moenie die gevaargebied alleen binnegaan nie. Moenie enige reddingspogings aanwend voordat al die besmette lug uitgewaai het nie, tensy die reddingspan suurstofasemhalingsapparaat dra. Elke reddingspan moet uit minstens drie persone bestaan.
3. Verwyder die pasiënt dadelik na die naaste vars lug.
4. Stel 'n verantwoordelike mynampenaar dadelik in kennis.
5. Indien asemhaling opgehou het of onreëlmatig is
 - (a) PAS KUNSMATIGE ASEMHALING TOE sodra die pasiënt in vars lug is. Vertraging kan die dood tot gevolg he.
 - (b) DIEN SUURSTOF TOE UIT DIE SILINDER.
6. As die pasiënt bewusteloos is, maar reëlmatig asemhaal, dien suurstof toe totdat hy bykom of minstens 'n halfuur lank voordat hy verwyder word. Moet in geen omstandighede water oor hom gooi nie.
7. As die pasiënt by sy bewussyn is, bring hom so gou moontlik na die oppervlak.
8. Alle gevalle van gasvergiftiging, hoe gering ook al, moet by die geneesheer aangemeld word. Moenie iemand wat aan gasvergiftiging ly, toelaat om te loop nie. Dra hom op 'n draagbaar.
9. Onthou dat die simptome van gasvergiftiging aanvanklik baie gering mag wees: prikkeling in die oë, neus en keel, 'n gevoel van beklemming in die bors of hoofpyn.

DIT IS GEVAARTEKENS

KO 702

400mm x 600mm

HEAT STROKE AND HEAT EXHAUSTION

SYMPTOMS

One or more of the following symptoms may be exhibited:

- Skin usually dry, always hot to the touch even though sweating may still occur.
- Quarrelsome, violent, hysterical running about - the patient may act as if he is insane.
- Spasms of the limb muscles like shivering - this may be mistaken for a "fit".
- Vacant staring of the eyes - the pupils are dilated.
- Loss of control over bladder and bowels.
- Collapse and unconsciousness.

Remember - when in doubt treat as for heat stroke, i.e. promptly cool the patient with water and compressed air.

TREATMENT

- Start treatment immediately and send for a shift boss, mine captain or ambulance officer.
- Remove all the patient's clothing. Keep his naked body wet with water and blow compressed air over him from a distance of 1 metre.
- Continue cooling until trained help arrives or until two hours have elapsed.
- Apply artificial respiration if breathing fails.
- Give small amounts of water to drink occasionally if the patient is conscious.
- After two hours of continuous cooling, or when directed by the official who has taken charge, the patient should be placed on a stretcher, covered lightly with a blanket and removed to hospital.

HITTE STEEK EN HITTE VERMOEIEENIS

SIMPTOME

Een of meer van die volgende simptome kan voorkom:

- Vel gewoonlik droog en altyd warm by aanraking, hoewel pasiënt dalk nog kan sweet.
- Die pasiënt kan handel asof hy waansinnig is - hy is skoorsoekerig, gewelddadig, of kan histories rondhardloop.
- Krampagtige sametrekking van spiere van ledemate soos bewering - dit kan vir stuip aangesien word.
- Die oë staan uitdrukkingloos - die pupille is verwyd.
- Verlies van vermoë om urineren en ontlasting te beheer.
- Ineenstorting en bewusteloosheid.

Onthou - as daar twyfel bestaan, pas die behandeling vir hittesteek toe, dit wil se koel die pasiënt dadelik met water en druklug af.

BEHANDELING

- Begin dadelik met die behandeling en ontbied 'n skofbaas, mynkaptein of ambulansbeampte.
- Trek al die pasiënt se klere uit, hou sy naakte liggaam nat met water, en blaas druklug oor hom van 'n afstand van 1 meter.
- Hou vol met afkoeling totdat opgeleide hulp opdaag of totdat twee uur verstryk het.
- Pas kunsmatige asemhaling toe indien die pasiënt se asemhaling verswak.
- Gee die pasiënt nou en dan klein hoeveelhede water om te drink indien hy by sy bewussyn is.
- Nadat die pasiënt twee uur lank onafgebroke afgekoel is, of wanneer opdrag daartoe gegee word deur die verantwoordelike amptenaar, moet die pasiënt op 'n draagbaar geplaas, liggies met 'n kombers toegemaak, en na 'n hospitaal gebring word.

KO 703

400mm x 600mm

DROWNING TREATMENT

1. Start artificial respiration **IMMEDIATELY**. Mouth to nose method can be done even before the patient is out of the water.

Do not waste time trying to empty water from patient's lungs, loosen clothing etc.

2. When on dry land turn patient on to face and carry on with Holger Nielsen method of artificial respiration.

3. Only at this stage remove wet clothing and keep patient warm.

NOTE: A VICTIM MAY BE REVIVED EVEN AFTER TOTAL IMMERSION OF 10 - 12 MINUTES

VERDRINKING BEHANDELING

1. Pas **ONMIDDELIK** kunsmatige asemhaling toe. Die mond-tot neusmetode kan reeds toegepas word voordat die pasiënt uit die water is.

Moenie tyd verkwis deur te probeer om die water uit die pasiënt se longe te kry en sy klere los te maak, ens. nie.

2. Wanneer droë grond bereik word, draai die pasiënt op sy maag en gaan voort met die Holger-Nielsen metode van kunsmatige asemhaling.

3. Verwyder nou eers die pasiënt se nat klere en hou hom warm.

LET WEL: 'N DRENKELING KAN BYGEBRING WORD SELFS NADAT HY 10 - 12 MINUTE HEELTEMAL ONDER DIE WATER WAS

KO 704

400mm x 600mm



FIRST AID TREATMENT OF ELECTRICAL ACCIDENTS

INSTRUCTIONS

1. DO NOT TOUCH VICTIM WITH BARE HANDS WHILST HE IS IN CONTACT WITH LIVE WIRE.
2. BREAK ELECTRICITY AT CONTACT:
(a) SWITCH OFF CURRENT IF POSSIBLE.
(b) ADEQUATELY INSULATE YOURSELF BY STANDING ON DRY WOOD OR A THICK FOLDED COAT.
3. THEN, USING A DRY ROPE, BELT OR STICK, PULL LIVE WIRE FROM VICTIM OR DRAG VICTIM AWAY FROM FIRE.
4. SEND FOR MEDICAL ASSISTANCE.

TREATMENT

1. **ASPHYXIA**
IF THE PATIENT IS NOT BREATHING DO ARTIFICIAL RESPIRATION.
2. **CARDIAC ARREST**
IF THE HEART IS NOT BEATING DO EXTERNAL HEART MASSAGE PLUS ARTIFICIAL RESPIRATION.
3. **BURNS AND OTHER INJURIES**
APPLY STERILISED DRESSINGS AND SPLINTS IF NECESSARY.



EERSTEHULPBEHANDELING BY ELEKTRISITEITSONGELUKKE

VOORSKRIFTE

1. MOENIE MET U KAAL HANDE AAN DIE SLAGOFFER RAAK ONDERWYL HY IN KONTAK MET 'N LEWENDIGE DRAAD IS NIE.
2. VERBREEK DIE ELEKTRIESE STROOM BY DIE KONTAK:
(a) SKAKEL DIE STROOM AF AS DIT MOONTLIK IS.
(b) ISOLEER U VOLDOENDE DEUR OP DROË HOUT OF 'N DIK GEVOUDE JAS TE STAAN.
3. GEBRUIK DAN 'N DROË TOU, LYFBAND OF STOK OM DIE LEWENDIGE DRAAD VAN DIE SLAGOFFER OF DIE SLAGOFFER VAN DIE DRAAD WEG TE SLEEP.
4. ONTBIED MEDIESE HULP.

BEHANDELING

1. **VERSMORING**
AS DIE PASIËNT NIE ASEMHAAL NIE, PAS KUNSMATIGE ASEMHALING TOE.
2. **HARTSTILSTAND**
AS DIE HART NIE KLOP NIE, PAS UITWENDIGE HARTMASSERING EN KUNSMATIGE ASEMHALING TOE.
3. **BRANDWONDE EN ANDER BESERINGS**
INDIEN NODIG, MOET GESTERILISEERDE VERBANDE EN SPALKE AANGESIT WORD.

KO 705

450mm x 610mm

FIRST AID TREATMENT OF ELECTRICAL ACCIDENTS

1. ENSURE VICTIM IS CLEAR OF LIVE APPARATUS OR CONDUCTORS
2. IF POSSIBLE SEND FOR MEDICAL ASSISTANCE
3. IF PATIENT IS BREATHING

MAKE PATIENT COMFORTABLE AND KEEP HIM AT NORMAL BODY TEMPERATURE COVER HIM WITH BLANKETS OR COATS ONLY IF HE IS COLD

4. IF PATIENT IS NOT BREATHING PERFORM RESCUE BREATHING AT ONCE



1. Tilt the victim's head back as far as possible. 2. Pinch the victim's nose with your thumb and forefinger. 3. Breathe into the victim's mouth. 4. Watch for the victim's chest to rise. 5. Repeat the process.

IF ON ACCOUNT OF FACIAL INJURIES OR OTHER REASONS, RESCUE BREATHING CANNOT BE PERFORMED, APPLY MANUAL METHOD OF RESUSCITATION

SYLVESTER BROCH METHOD OF ARTIFICIAL RESPIRATION



1. Place your hand over the victim's mouth. 2. Push your hand down against the victim's chest. 3. Release your hand. 4. Repeat the process.

NEILSEN'S METHOD OF ARTIFICIAL RESPIRATION



1. Place your hand over the victim's mouth. 2. Push your hand down against the victim's chest. 3. Release your hand. 4. Repeat the process.

5. BURNS AND OTHER INJURIES

IF VICTIM CAN BE TAKEN TO HOSPITAL QUICKLY DO NOT DRESS BURNS. IF NOT DRESS BURNS WITH VASELINE GAUZE. APPLY STERILISED DRESSING TO WOUNDS

NOODHULP IN DIE GEVAL VAN ELEKTRIESE SKOK

1. SORG DAT DIE PASIËNT WEG VAN LEWENDIGE APPARAAT OF GELEIERS IS
2. ONTBIED MEDIESE HULP AS DIT MOONTLIK IS
3. AS DIE PASIËNT ASEMHAAL

SORG DAT PASIËNT GERIEFLIK IS EN HOU HOM BY NORMALE LIGGAAMSTEMPERATUUR. MAAK HOM NET MET KOMBERSE EN JASSE TOE AS HY ROUD IS

4. AS DIE PASIËNT NIE ASEMHAAL NIE

PAS ONTMIDDELIK DIE ASEMINBLAASMETODES VAN KUNSMATIGE ASEMHALING TOE



1. Tilt the victim's head back as far as possible. 2. Pinch the victim's nose with your thumb and forefinger. 3. Breathe into the victim's mouth. 4. Watch for the victim's chest to rise. 5. Repeat the process.

INDIEN DIE INBLAASMETODES VANWEE GESIGBESERINGS OF OM ANDER REDES NIE TOEGEPAN KAN WORD NIE. PROBEER DIE PASIËNT MET DIE HANDOORLUKMETODES BYRIJN

SYLVESTER BROCH SE METODE VAN KUNSMATIGE ASEMHALING



1. Place your hand over the victim's mouth. 2. Push your hand down against the victim's chest. 3. Release your hand. 4. Repeat the process.

NEILSEN SE METODE VAN KUNSMATIGE ASEMHALING



1. Place your hand over the victim's mouth. 2. Push your hand down against the victim's chest. 3. Release your hand. 4. Repeat the process.

5. BRANDWONDE EN ANDER BESERINGS

MOENIE DIE BRANDWONDE VERBIND AS DIE PASIËNT GOU NA DIE HOSPITAAL TOE GENEEM KAN WORD NIE. SO NIE. BEDEK DIE WONDE MET VASELINE GAAS. GEBRUIK STERIELE VERBANDE OP WOND

KO 706

450mm x 610mm

SIZES:
GROOTTES:

290mm x 290mm; 440mm x 440mm

UNLESS OTHERWISE STATED
TENSY ANDERS VERMELD



KO 707



KO 708



KO 711



KO 709


400mm x 600mm



KO 712 300mm x 230mm

KO 713 200mm x 140mm

KO 714 150mm x 100mm

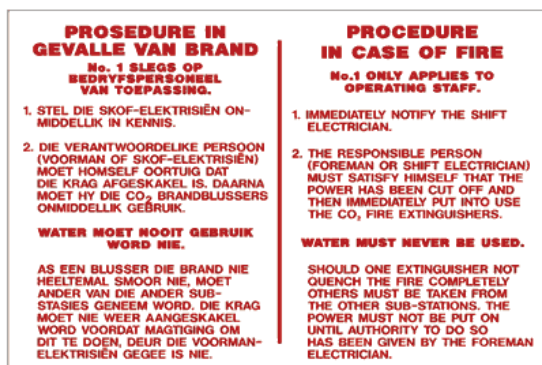

KO 710

400mm x 600mm



KO 715



KO 716



KO 717

SIZES:
GROOTTES:

290mm x 290mm; 440mm x 440mm

UNLESS OTHERWISE STATED
TENSY ANDERS VERMELD

CRANE SIGNALS KRAANTEKENS ORDER/BEVEL	VISUAL SIGNAL SIGBARE TEKEN
RAISE HYS	
LOWER LAAT SAK	
RAISE SLOWLY HYS STADIG	
LOWER SLOWLY SAK STADIG	
STOP	
LONG OR X TRAVEL OORLANGSE OF DWARSBEWEGING	 DIRECTION RIGTING

KO 720 1,100mm x 550mm
KO 721 920mm x 390mm
KO 722 400mm x 170mm



KO 724

ABS

KO 724 A (1) 1250mm x 625mm
KO 724 A (2) 833mm x 416mm
KO 724 A (3) 625mm x 416mm

CHROMADEK

KO 724 C (1) 925mm x 915mm
KO 724 C (2) 925mm x 615mm
KO 724 C (3) 610mm x 457mm




KO 725



KO 726 (A)



KO 726 (B)

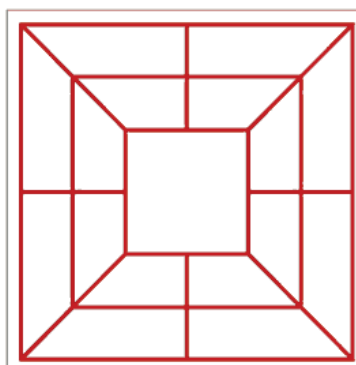

KO 732

FIRST-AID TREATMENT FOR ELECTRICAL ACCIDENTS

IT'S AS SIMPLE AS THE

A AIRWAY



CHECK THE PERSON ARE YOU OKAY?

B BREATHING



CHECK FOR PULSE IF NO BREATHING, START RESCUE BREATHING

C CIRCULATION



IF NO PULSE 1. PLACE TWO FINGERS ON LAST PART OF BREAST ONE 2. PLACE OTHER HAND NEXT TO TWO FINGERS

A AIRWAY

TILT HEAD LIFT CHIN

B BREATHING

KEEP HEAD TILTED CLOSE PERSON'S NOSE TAKE A DEEP BREATH

MOUTH TO MOUTH RESCUE BREATHING COVER PERSON'S MOUTH COMPLETELY WITH YOUR MOUTH BLOW INTO PERSON'S MOUTH TWICE

IF PERSON HAS PULSE DO RESCUE BREATHING ONLY

C CIRCULATION

CORRECT HAND POSITION THEN PLACE HAND ON TOP OF HAND

COMPACT CHEST COMPRESSIONS PUSH HARD AND FAST ABOUT 150-200 TIMES PER MINUTE

IF PERSON IS BREATHING AND HAS A PULSE THEN TURN ONTO HIS/HER SIDE

KO 706 A

410mm x 610mm



KO 734



KO 735



KG 747



KG 749



KG 751



KG 752



KG 753



KG 754



KG 755



KG 756



KG 757



KG 758



KG 759



KG 760



KG 761



KG 762



KG 763 880mm x 440mm



KG 764



KG 765



KG 764E



KG 766



KG 767



KG 768



KG 769



KG 770




KG 771



KG 773 880mm x 440mm



KG 774

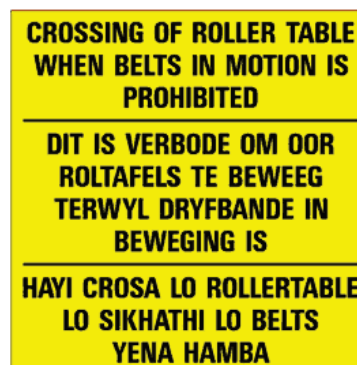

KG 775



KG 776 880mm x 440mm



KG 777



KG 778



KG 780



KG 781



KG 782




KG 783



KG 784



KG 785

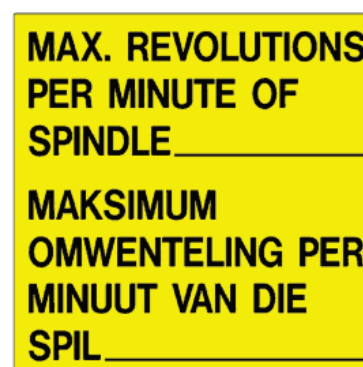

KG 786



KG 787



KG 788



KG 789



KG 794



KG 795



KG 796

YOU WORK WITH FOOD
CLEAN YOUR HANDS
BEFORE RETURNING

JY WERK MET VOEDSEL
WAS JOU HANDE
VOORDAT JY TERUGKEER

KG 797



KG 798

BRAND
VERSAMELPUNT

FIRE
ASSEMBLY POINT

KG 799



KG 800



KG 801



KG 802



KG 803



KG 803 A



KG 803 B



KG 804




KG 802 A



KG 802 B

**Give the
NEW guy
safety tips**



KG 814

**TAKE
CARE
NOT
CHANCES**



KG 815

**NEVER
RELAX
ON
SAFETY**



KG 816



**ACCIDENTS
ROB YOU
TOO**

KG 817

**LIFT WITH YOUR
LEGS**



KG 818

**CHANCE TAKERS
GET IT
IN
THE
END**



KG 819

**ACCIDENTS
ARE
NO
FUN**



KG 820

**GET FIRST AID
FAST
NOT
LAST**



KG 821

**PUSH
DON'T
PULL**



KG 822

YOU CAN'T BE



TOO CAREFUL

KG 823

**NOBODY BUT ME
WOULD TRY TO
CARRY A
LOAD THAT'S
TOO HEAVY!**



KG 824

**TOOLS DON'T CAUSE
ACCIDENTS
IT'S THE
PEOPLE
WHO USE THEM**



KG 825


WHAT EXCUSE



**JUSTIFIES AN
ACCIDENT?**

KG 826

WHICH ONE WASN'T CAREFUL?

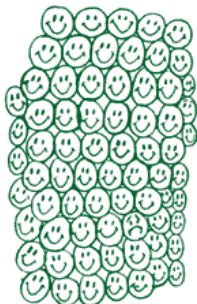

KG 827

**I'M CONVINCED
NOW**



KG 828

ACCIDENTS



CAN

COST

PLENTY

KG 829

**DAYDREAMING
ON THE JOB**



**GETS YOU INTO
TROUBLE**

KG 830


IS YOUR SAFETY RECORD



UP TO PAR?

KG 831

GOOD HOUSEKEEPING



IS GOOD ANYWHERE

KG 832

DON'T TWIST



SHIFT YOUR FEET

KG 833

**ACCIDENTS
AREN'T FUN**



I'VE HAD ONE

KG 834

KEY YOURSELF



TO

SAFETY

KG 835

A GOOD NIGHT'S



**MEANS A SAFER
DAY'S WORK**

KG 836

ACCIDENTS

DON'T

JUST

HAPPEN

THEY ARE CAUSED



KG 837

**SIZES:
GROOTTES:**









290mm x 290mm; 440mm x 440mm

**UNLESS OTHERWISE STATED
TENSY ANDERS VERMELD**

SYMBOLIC SAFETY SIGNS - AMAPHAWU WOKUPHEPHA - SIMBOLIESE VEILIGHEIDSTEKEN

 DIRECTION OF FLOW DIREKSIE VAN STROMING DIREKSIE VAN STROMING	 FIRE EXTINGUISHER FIRE EXTINGUISHER FIRE EXTINGUISHER	 FIRST AID FIRST AID FIRST AID	 FIRE ALARM FIRE ALARM FIRE ALARM	 FIRE ALARM FIRE ALARM FIRE ALARM	 FIRE ALARM FIRE ALARM FIRE ALARM	 FIRE ALARM FIRE ALARM FIRE ALARM	 FIRE ALARM FIRE ALARM FIRE ALARM	 FIRE ALARM FIRE ALARM FIRE ALARM	 FIRE ALARM FIRE ALARM FIRE ALARM	 FIRST AID FIRST AID FIRST AID	 EXIT EXIT EXIT
 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT
 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT
 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT
 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT
 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT
 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT	 EXIT EXIT EXIT

COLOUR CODES - IMIBALA EKHOMBAYO - KLEURKODES

 DRINKABLE COLD WATER DRINKABLE COLD WATER DRINKABLE COLD WATER	 DRINKABLE COLD WATER DRINKABLE COLD WATER DRINKABLE COLD WATER	 ACID ACID ACID	 CORROSION CORROSION CORROSION
 DRINKABLE HOT WATER DRINKABLE HOT WATER DRINKABLE HOT WATER	 DRINKABLE HOT WATER DRINKABLE HOT WATER DRINKABLE HOT WATER	 ALKALI ALKALI ALKALI	 CORROSION CORROSION CORROSION
 NON-DRINKABLE HOT WATER NON-DRINKABLE HOT WATER NON-DRINKABLE HOT WATER	 NON-DRINKABLE HOT WATER NON-DRINKABLE HOT WATER NON-DRINKABLE HOT WATER	 ACETYLENE ACETYLENE ACETYLENE	 CORROSION CORROSION CORROSION
 NON-DRINKABLE COLD WATER NON-DRINKABLE COLD WATER NON-DRINKABLE COLD WATER	 NON-DRINKABLE COLD WATER NON-DRINKABLE COLD WATER NON-DRINKABLE COLD WATER	 ACID ACID ACID	 CORROSION CORROSION CORROSION
 NON-DRINKABLE COLD WATER NON-DRINKABLE COLD WATER NON-DRINKABLE COLD WATER	 NON-DRINKABLE COLD WATER NON-DRINKABLE COLD WATER NON-DRINKABLE COLD WATER	 ACID ACID ACID	 CORROSION CORROSION CORROSION
 NON-DRINKABLE COLD WATER NON-DRINKABLE COLD WATER NON-DRINKABLE COLD WATER	 NON-DRINKABLE COLD WATER NON-DRINKABLE COLD WATER NON-DRINKABLE COLD WATER	 ACID ACID ACID	 CORROSION CORROSION CORROSION
 NON-DRINKABLE COLD WATER NON-DRINKABLE COLD WATER NON-DRINKABLE COLD WATER	 NON-DRINKABLE COLD WATER NON-DRINKABLE COLD WATER NON-DRINKABLE COLD WATER	 ACID ACID ACID	 CORROSION CORROSION CORROSION
 NON-DRINKABLE COLD WATER NON-DRINKABLE COLD WATER NON-DRINKABLE COLD WATER	 NON-DRINKABLE COLD WATER NON-DRINKABLE COLD WATER NON-DRINKABLE COLD WATER	 ACID ACID ACID	 CORROSION CORROSION CORROSION
 NON-DRINKABLE COLD WATER NON-DRINKABLE COLD WATER NON-DRINKABLE COLD WATER	 NON-DRINKABLE COLD WATER NON-DRINKABLE COLD WATER NON-DRINKABLE COLD WATER	 ACID ACID ACID	 CORROSION CORROSION CORROSION

**FLOOR DEMARICATIONS
ISILINGANISO SAPHANSI
VLOER SKEIDINGSLYNE**



**NO STOPPING
NO STOPPING
NO STOPPING**



**STOCKING AREAS
STOKING AREAS
STOKING AREAS**



**WHITE
WHITE
WHITE**



**STOCKING AREAS
STOKING AREAS
STOKING AREAS**

KG 838

925mm x 615mm CHROMADEK



KG 850



KG 851



KG 852



KG 853



KG 854



KG 855



KG 856



KG 857



KG 858



KG 859



KG 860




KG 861



KG 862



KG 863

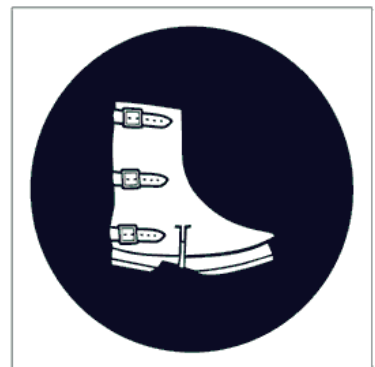

KG 864



KG 865



KG 866



KG 867



KG 868



KG 869




KG 870



KG 871



KG 872

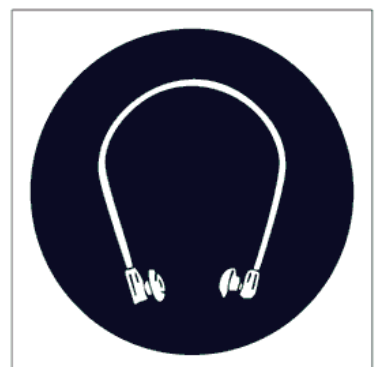

KG 873

SIZES:
GROOTTES:

290mm x 290mm; 440mm x 440mm


UNLESS OTHERWISE STATED
TENSY ANDERS VERMELD



KG 880



KG 881



KG 882



KG 889



KG 883



KG 884



KG 885



KG 890



KG 886



KG 887



KG 888



KG 891

HAZCHEM STICKERS / PLAKKERS



KS 959

400mm x 700mm



● = 600mm; 900mm; 1200mm

▼ = 900mm; 1200mm; 1500mm



R1



R1.2



R1.4



R1.5



R2



R4.3



R2.1



R2.2



R3



R4.1



R4.2



R5



R101



R102



R103



R114



R115



R116



R104



R105



R106



R107



R108



R117



R109



R110



R111



R112



R113



R118



R119



R120



R121



R122



R123



R129



R124



R125



R126



R127



R128



R134



R201



R130



R131



R132



R133



R135



R136



R202

● = 600mm; 900mm; 1200mm

▼ = 900mm; 1200mm; 1500mm



R203



R204



R205



R206



R207



R223



R227



R208



R209



R210



R211



R212



R224



R218



R213



R214



R215



R216



R217



R225



R219



R220



R221



R222



R226



W101



W102



W104



W105



W106



W107



W108



W109



W111



W112



W113



W114



W115



W103



W116



W117



W118



W119



W201



W110



W202



W203



W204



W205



W206

● = 600mm; 900mm; 1200mm

▼ = 900mm; 1200mm; 1500mm



W207



W208



W209



W210



W211



W320



W212



W213



W214



W215



W216



W325



W217



W218



W301



W302



W303



W330



W306



W307



W308



W309



W310



W335



W311



W312



W313



W314



W315



W348



W331



W332



W333



W334



W318



W319



W339



W344



W345



W346



W323



W324



W322



W316



W317



W326



W327



W328



W329



W321

● = 600mm; 900mm; 1200mm

▼ = 900mm; 1200mm; 1500mm



W401



W402



W403



W404



W405



W407



W406



W408



W409



W410



W316



W317



W318



W319



TR201



TR103



TR104



TR105



TR109



TR209



TR212



TR117



TR125



TR127



TR130



TR133



TR216



TR217



TR201



TR202



TR204



TR205



TR208



TR213



TR214



TR218



TR223



TR230



TR215

● = 600mm; 900mm; 1200mm

▼ = 900mm; 1200mm; 1500mm



TR232



TR233



TR305P



TR312P



TR322P



TW331



TW333



TW101



TW104



TW108



TW109



TW111



TW335



TW336



TW112



TW204



TW211



TW212



TW213



TW338



TW339



TW214



TW216



TW301



TW302



TW303



TW343



TW344



TW304



TW305



TW325



TW327



TW328



TW340



TW341



TW346



TW347



TW337



TW401



TW402



TW405

TW406



TW353



TW342



TW410



TW411



TW407



TW408